SPLIT TYPE ROOM AIR CONDITIONER Compact Cassette / Slim Duct / Mini Duct / Wall Mounted INVERTER MULTI

# SERVICE INSTRUCTION

#### Models Indoor unit

AS\* G07KGTB AS\* G09KGTB AS\* G12KGTB AS\* G14KGTB

AS\* G07KMTB AS\* G09KMTB AS\* G12KMTB AS\* G14KMTB

AS\*G07KETA (-B) AS\*G09KETA (-B) AS\*G12KETA (-B) AS\*G14KETA (-B)

ARXG07KSLAP ARXG09KSLAP ARXG12KSLAP ARXG14KSLAP

ARXG07KLLAP ARXG09KLLAP ARXG12KLLAP ARXG14KLLAP

AUXG07KVLA AUXG09KVLA AUXG12KVLA AUXG14KVLA

## **Outdoor unit**

AO\* G14KBTA2 AO\* G18KBTA2

#### Indoor unit

RSG07KGTB RSG09KGTB RSG12KGTB RSG14KGTB

# Outdoor unit

ROG14KBTA2 ROG18KBTA2

RSG07KMTB RSG09KMTB RSG12KMTB RSG14KMTB

RSG07KETA (-B) RSG09KETA (-B) RSG12KETA (-B) RSG14KETA (-B)

RDG07KSLAP RDG09KSLAP RDG12KSLAP RDG14KSLAP

RDG07KLLAP RDG09KLLAP RDG12KLLAP RDG14KLLAP

RCG07KVLA RCG09KVLA RCG12KVLA RCG14KVLA

# FUJITSU GENERAL LIMITED





# Compact Cassette / Slim Duct / Mini Duct / Wall Mounted INVERTER (MULTI)

# **2. TROUBLE SHOOTING**


#### 2-1 INDOOR UNIT AND WIRED REMOTE CONTROLLER DISPLAY

Check the Error LED display on the Indoor unit (IR Receiver \*Option)

- 1. Check ECONOMY (Green) LED Blinking, it means the Error on the system. (Not brinking: No Error)
- 2. Count OPERATION (Green) LED blinks: The number of blinking means the first digit of Error code.
- 3. Count TIMER (Orange) LED blinks: The number of blinking means the second digit of Error code.
- Ex.) ECONOMY: Blinking continuous / OPERATION: 4 times / TIMER: 1 time ⇒ Indoor Room Thermistor Error

Check the Error code on the wired remote controller (Remote controller \*Option)


- 1. If an error occurs, an error icon appears on the "Monitor mode screen".
- Touch the [Status] on the "Monitor mode screen". The "Status" screen is displayed.
- 2. Touch the [Error Information] on the "Status" screen. The "Error Information" screen is displayed.
- (If there are no errors, the [Error Information] will not be displayed.)
- 3. 2-digit numbers correspond to the error code in the table below. Touch the [Next page] (or [Previous page]) to switch to other connected indoor units.




For the details of the indoor unit or outdoor unit error , refer to the error codes in each installation manual

| Error Contents  | Error<br>Code | Trouble shooting | Error Contents                                | Error<br>Code | Trouble<br>shooting |
|---|---------------|------------------|---|---------------|---------------------|
| Serial Communication Error  | 11            | 1,2              | Outdoor unit main PCB model information error | 62            | 18                  |
| Wired Remote Controller<br>Communication Error                              | 12            | 3                | Inverter Error                                | 63            | 19                  |
| External communication Error  | 18            | 4                | PFC circuit Error                             | 64            | 20                  |
| Indoor unit capacity Error  | 22            | 5                | Trip terminal L Error                         | 65            | 21                  |
| Combination Error   | 23            | 6                | Discharge Thermistor Error                    | 71            | 22                  |
| Indoor unit address setting Error   | 26            | 7                | Compressor Thermistor Error                   | 72            | 23                  |
| Connection unit number Error<br>(Indoor unit Wired remote controller Error) | 29            | 8                | Heat Ex. Outlet / Middle<br>Thermistor Error  | 73            | 24                  |
| Indoor unit PCB model<br>information Error                                  | 32            | 9                | Outdoor Thermistor Error                      | 74            | 25                  |
| Indoor unit motor electricity<br>consumption detection Error                | 33            | 10               | 2-way Valve Thermistor Error                  | 76            | 26-1                |
| Manual auto switch Error  | 35            | 11               | 3-way Valve Thermistor Error                  | 76            | 26-2                |
| Indoor unit power supply Error<br>for fan motor                             | 39            | 12               | Current sensor Error                          | 84            | 27                  |
| Indoor unit Communication circuit<br>(wired remote controller) Error        | 3A            | 13               | Trip detection                                | 94            | 29                  |
| Indoor Room Thermistor Error  | 41            | 14               | Compressor rotor position<br>detection Error  | 95            | 30                  |
| Indoor Heat Ex. Thermistor Error  | 42            | 15               | Outdoor Unit Fan Motor Error                  | 97            | 31                  |
| Indoor Unit Fan Motor Error   | 51            | 16               | 4-way Valve Error                             | 99            | 32                  |
| Drain pump Error  | 53            | 17               | Discharge Temp. Error                         | A1            | 33                  |

#### **2-2 TROUBLESHOOTING WITH ERROR CODE**

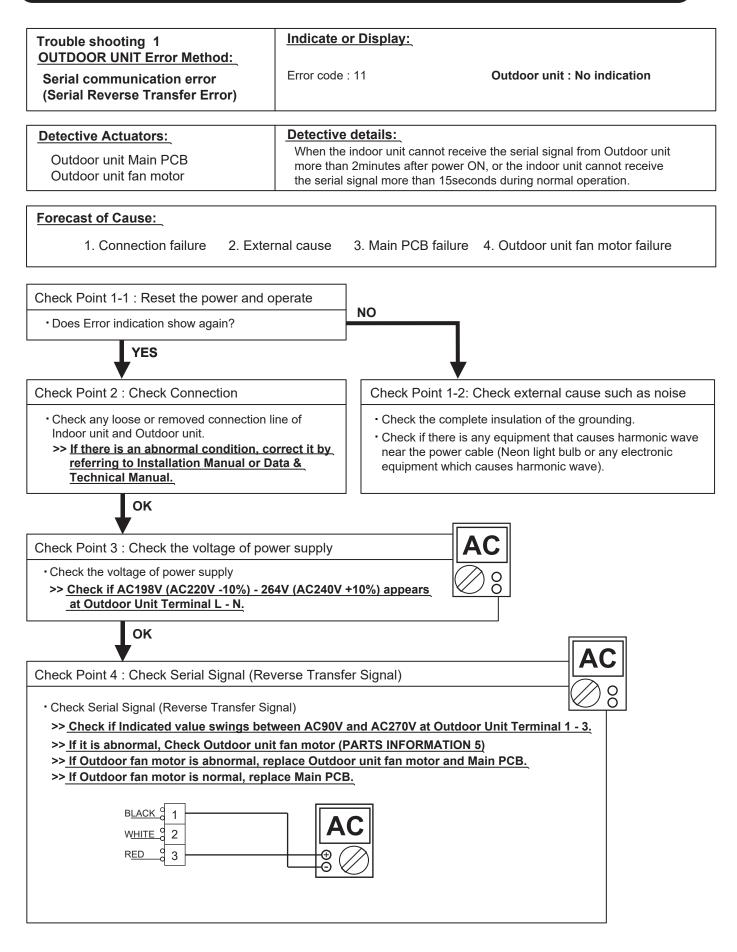

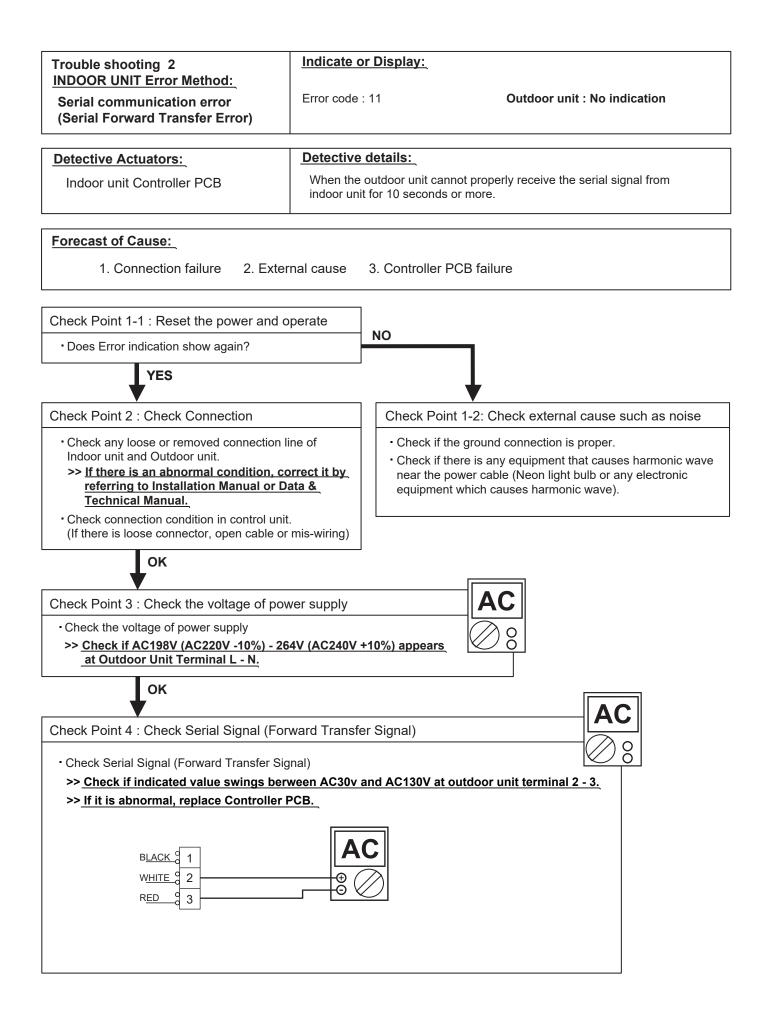


| Trouble shooting 3<br>INDOOR UNIT Error Method:  | Indicate or Display:   |         |
|--|--|---------|
| Wired Remote Controller<br>Communication Error   | Error code : 12 Outdoor unit : No indication   |         |
|  |  |         |
| Detective Actuators:   | Detective details:   |         |
| Indoor unit Controller PCB<br>Wired Remote Controller  | Upon receiving the signal more than 1 time from Wired Remote or other Ind<br>unit, but the same signal has not been received more than 1 minute<br>(3 Wire type), 2.5 minute (2 Wire type) | 001     |
| Forecast of Cause:   |  |         |
|  | d Remote Controller failure 3. Controller PCB failure  |         |
|  |  |         |
| Check Point 1 : Check the connection of  | terminal   |         |
| After turning off the power.<br>Check & correct the followings.  |  |         |
| <ul> <li>Check the connection of terminal berweer<br/>and check if there is a disconnection of th</li> </ul> | ,  |         |
| ОК   |  |         |
| Check Point 1-2 : Check Wired Remote   | Controller and Controller PCB  |         |
| For AS* G KGTB   |  |         |
| Check Voltage at CN300 (Terminal 1-2) of   | f UTY-TWRXZ2 (Communication kit).  |         |
| (Power supply to Remote control)<br>>> If it is DC12V, Remote control is failure                             | (Controllor BCR is normal)   | 2       |
|  | e. (Controller PCB is normal) >> Replace Remote control<br>(Check Remote control once again) >> Replace Controller PCB   | <u></u> |
| For AS* G KMTB   |  |         |
| Check Voltage at CNC01 (Terminal 1-3) o<br>(Power supply to Remote control)                                  | f UTY-TWBXF2 (Communication kit).  |         |
| <ul> <li>&gt;&gt; If it is DC13V, Remote control is failure</li> </ul>                                       | e. (Controller PCB is normal) >> Replace Remote control  |         |
| >> If it is DC 0V, Controller PCB is failure.  | (Check Remote control once again) >> Replace Controller PCB  |         |
| For AR type  |  |         |
| Check Voltage at CN300 of Controller PC<br>(Power supply for the Remote Control)                             | B. (Terminal 1-3, Terminal 1-2)  |         |
| >> If it is DC13V, Remote control is failure   | e. (Controller PCB is normal) >> Replace Remote control  |         |
|  | (Check Remote control once again) >> Replace Controller PCB  |         |
| For AU type  |  |         |
| Check Voltage at CN14 of Controller PCB<br>(Power supply for the Remote Control)                             | . (Terminal 1-3, Terminal 1-2)   |         |
| >> If it is DC12V, Remote control is failure<br>>> If it is DC 0V, Controller PCB is failure.                | e. (Controller PCB is normal) >> Replace Remote control<br>(Check Remote control once again) >> Replace Controller PCB   |         |
| Upon correcting the removed connect  | or or mis-wiring, reset the power.   |         |
|  |  |         |
|  |  |         |

Check Point 2 : Wire installation Wrong RCgroup setting
 Wrong wire connection in RCgroup (Please refer to the installation manual)
 The number of connecting indoor unit and Remote controller in one RCgroup were less than 16 units.

Check Point 2-1 : Check Indoor unit controller PCB

Check if controller PCB damage.

□ Change controller PCB and check the Error after setting remote controller address.

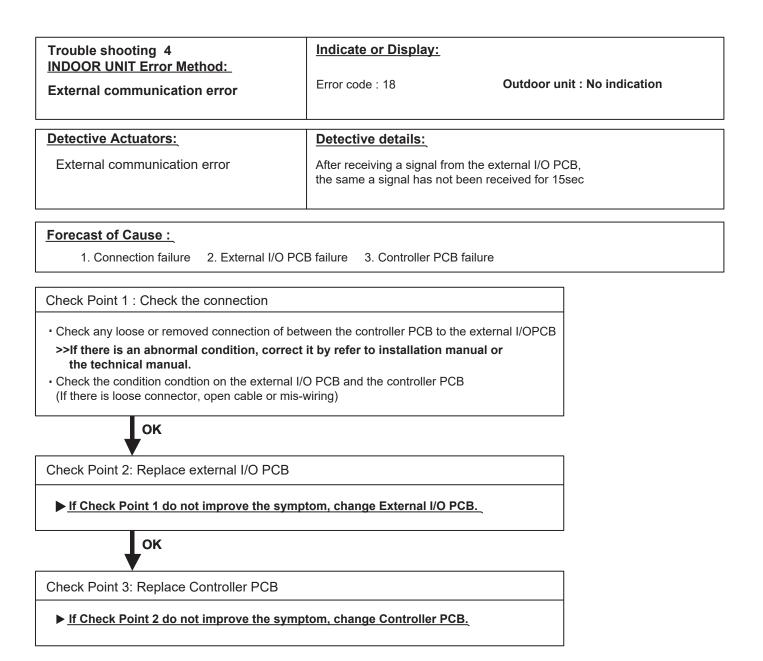

| Trouble shooting 5<br>OUTDOOR UNIT Error Method:   | Indicate or Display:     |   |  |  |
|--|--------------------------|---|--|--|
| Indoor unit capacity error   | Error code : 22          | Outdoor unit : No indication            |  |  |
| Detective Actuators:   | Detective details:       |   |  |  |
| All indoor units   | The total capacity of th | e indoor units if it is install beyond. |  |  |
| Forecast of Cause :         1. The selection of indoor units is incorrect       2. Main PCB(Outdoor unit) failure  |                          |   |  |  |
| Check Point 1 : Check the total capacity of indoor unit  |                          |   |  |  |
| <ul> <li>Check the total capacity of the connected indoor units.</li> <li>&gt; If abnormal condition is found, correct it by referring<br/>to Installation Manual or Design &amp; Technical Manual.</li> </ul> |                          |   |  |  |
| ок   |                          |   |  |  |
| Check Point 2 : Replace Main PCB   |                          |   |  |  |

▶ If Check Point 1 do not improve the symptom, replace Main PCB of Outdoor unit.

| Trouble shooting 6<br>INDOOR UNIT Error Method:  | Indicate or Display: |  |  |  |
|--|----------------------|--|--|--|
| Combination error  | Error code : 23      | Outdoor unit : No indication   |  |  |
| Detective Actuators:   | Detective details:   |  |  |  |
| Indoor unit  |                      | es the serial signal of applied refrigerant unit. When the refrigerant is R410a. |  |  |
| Forecast of Cause:   |                      |  |  |  |
| 1. The selection of indoor units is ind  | correct              |  |  |  |
| Check Point 1 : Check the type of indoor uni   | t                    |  |  |  |
| Check the type of the connected indoor unit.     > If abnormal condition is found, correct it. |                      |  |  |  |
| ок   |                      |  |  |  |
| Check Point 2 : Replace Main PCB   |                      |  |  |  |
| ▶ If Check Point 1 do not improve the symptom, replace Main PCB of Outdoor unit.               |                      |  |  |  |

| Trouble shooting 7<br>INDOOR UNIT Error Method:  | Indicate or Display:   |  |
|--|------------------------|--|
| Indoor unit address setting error  | Error code : 26        | Outdoor unit : No indication   |
| Detective Actuators:<br>Wired remote controller ( 2-Wire )<br>Indoor unit Controller PCB circuit | mixed in one RC group. | r set by auto setting and manual setting are<br>ess number exists in one RC group. |

#### Forecast of Cause :

1. Wrong wiring of RCgroup 2. Wrong remote address setting 3. Indoor unit controller PCB failure 4. Remote controller failure

Check Point 1 : Wire installation

Uvrong wire connection in RCgroup (Please refer to the installation manual)

ок

Check Point 2 : Wrong RCgroup setting

- □ The given address number by auto setting (00) and the manual set number (Except 00) were not existing in one RCG.
- $\hfill\square$  The remote controller address setting by U.I. were not existing same address.
- The duplicated address number is not existing in one RCgroup

Check Point 3 : Check Indoor unit controller PCB

Check if controller PCB damage

Change controller PCB and check the Error after setting remote controller address


| Trouble shooting 8 <u>INDOOR UNIT Error Method;</u>                          | Indicate or Display:  |                              |
|--|---|------------------------------|
| Connection unit number error (Indoor unit in Wired remote controller system) | Error code : 29   | Outdoor unit : No indication |
| Detective Actuators:   | Detective details:  |                              |
| Wired remote controller ( 2-Wire )<br>Indoor unit Controller PCB circuit     | When the number of connecting indoor units are out of specified rule. |                              |
| Forecast of Cause :  | in RCgroup 2. Indoor unit controller PCI                              | B defective                  |
| Check Point 1 : Wire installation  |   |                              |
| Wrong number of connecting indoor unit                                       |   |                              |
| ок   |   |                              |
| Check Point 2 : Check Indoor unit contro                                     | ller PCB  |                              |
| □ Check if controller PCB damage   |   |                              |
| Chaok if controller DCP and chaok the Err                                    |   |                              |

 $\ensuremath{\square}$  Check if controller PCB and check the Error after setting remote controller address


| Trouble shooting 9<br>INDOOR UNIT Error Method: | Indicate or Display: |   |  |
|---|----------------------|---|--|
| Indoor unit PCB<br>model information error      | Error code : 32      | Outdoor unit : No indication  |  |
| Detective Actuators:                            | Detective details:   |   |  |
| Indoor unit Controller PCB                      | 1. When model inform | <ul><li>When power is on and there is some below case.</li><li>1. When model information of EEPROM is incorrect.</li><li>2. When the access to EEPROM failed.</li></ul> |  |

#### Forecast of Cause:

1. External cause 2. Defective connection of electric components 3. Controller PCB failure

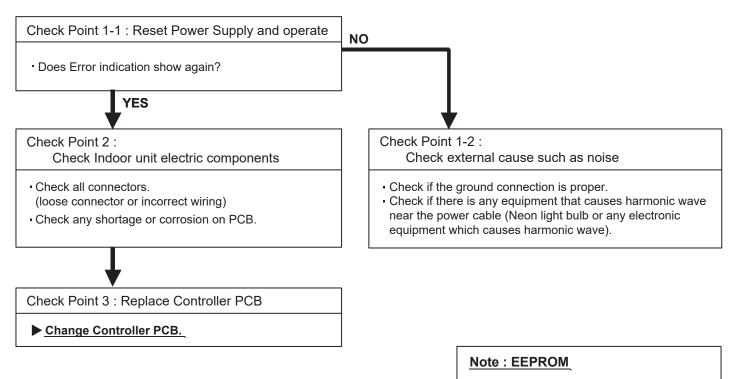

#### EEPROM(Electronically Erasable and Programmable Read Only Memory) is a nonvolatile memory which keeps memorized information even if power is turned off. It can change the contents electronically. To change the contents, it uses higher voltage than normal, and it can not change a partial contents. (Rewriting shall be done upon erasing the all contents.) There is a limit in a number of rewriting.




#### Detective Actuators:

#### Detective details:

Indoor unit fan motor Indoor unit Controller PCB circuit When the voltage value or the current value of the motor go beyond the limits.

#### Forecast of Cause:

1. Fan motor failure 2. Controller PCB failure

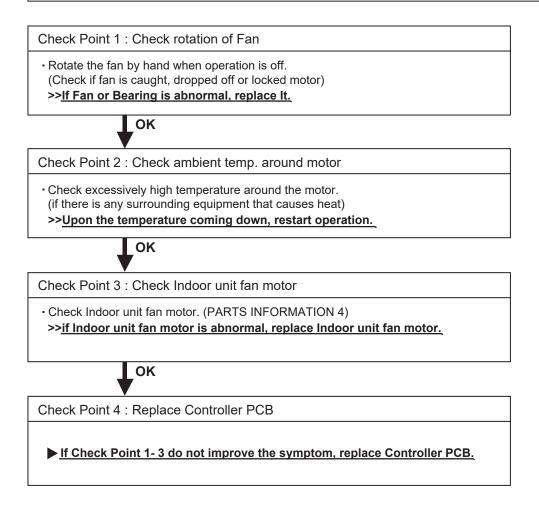



| Trouble shooting 11<br>INDOOR UNIT Error Method:   | Indicate or Display:   |  |  |  |
|--|--|--|--|--|
| Manual auto switch Error   | Error code : 35 Outdoor unit : No indication                               |  |  |  |
|  |  |  |  |  |
| Detective Actuators:   | Detective details:   |  |  |  |
| Indoor unit Controller PCB<br>Indicator PCB<br>Manual auto switch  | When the Manual Auto Switch becomes ON for consecutive 60 or more seconds. |  |  |  |
|  |  |  |  |  |
| Forecast of Cause:   |  |  |  |  |
| 1. Manual auto switch failure 2. Controller PCB and Indicator PCB failure  |  |  |  |  |
|  |  |  |  |  |
| Check Point 1 : Check the Manual auto switch   |  |  |  |  |
| <ul> <li>Check if Manual auto switch is kept pressed.</li> <li>Check ON/OFF switching operation by using a meter.</li> <li>&gt;<u>If Manual auto switch is disabled (on/off switching), replace it.</u></li> </ul> |  |  |  |  |



Check Point 2 : Replace Controller PCB

► If Check Point 1 do not improve the symptom, change Controller PCB and Indicator PCB.

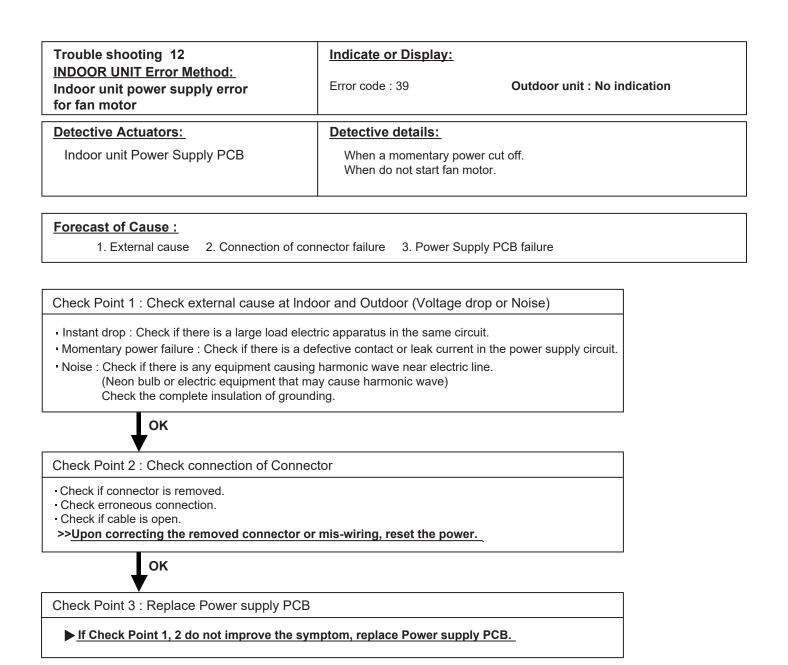

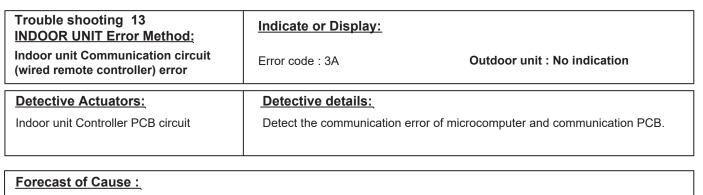



1.Communication PCB defective 2. Indoor unit controller PCB defective

Check Point 1 : Check the connection of terminal
After turning off the power supply, check & correct the followings
Indoor unit - Check the connection the communication PCB and the controller PCB
OK
Check Point 2 : Replace the communication PCB
If the Check point 1 is ok, replace the communication PCB
OK


Check Point 3 : Replace the controller PCB

If condition is doesn't change, replace the controller PCB

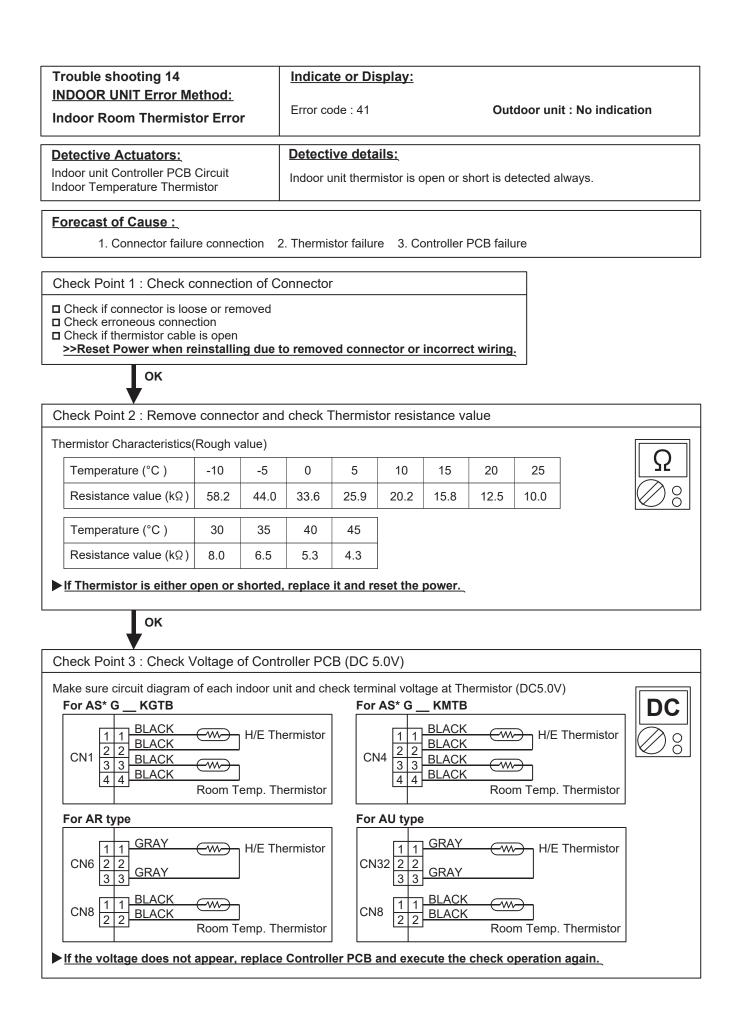


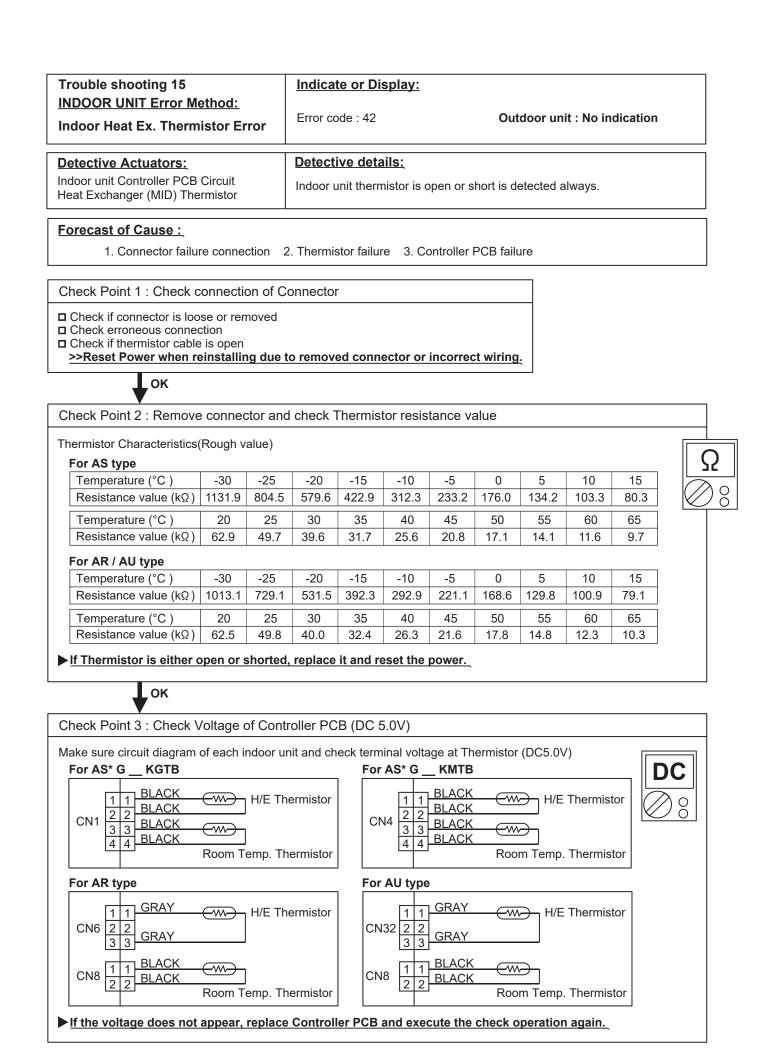


02-16

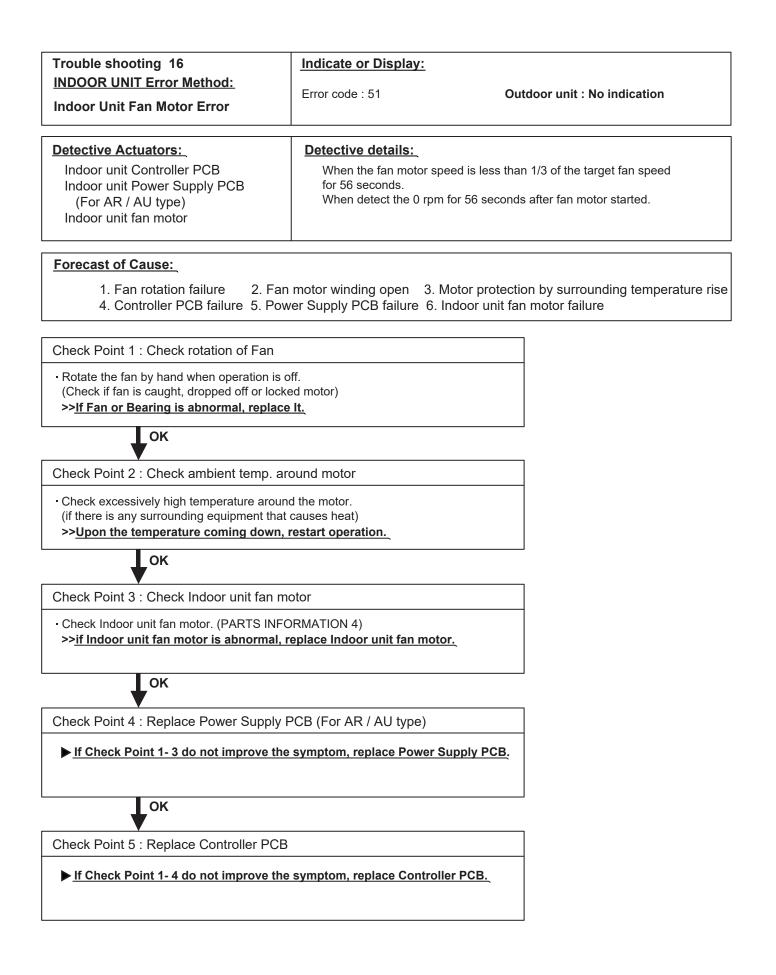

#### For AR / AU type

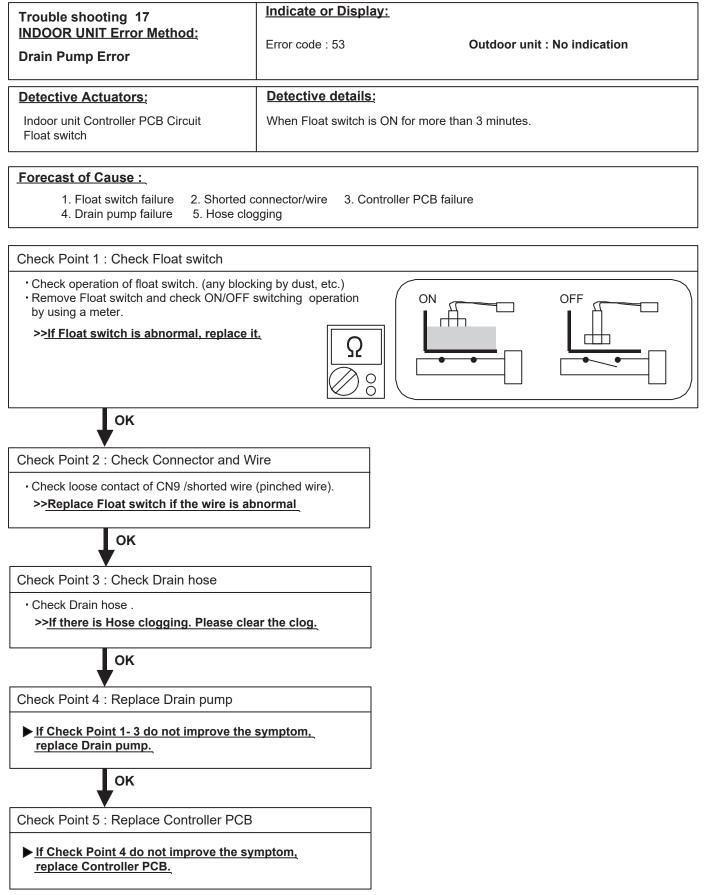

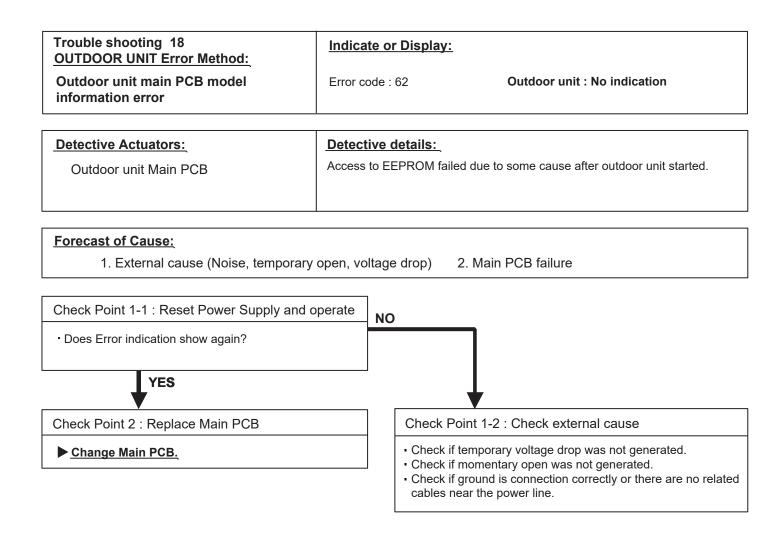

| Trouble shooting 19<br>OUTDOOR UNIT Error Method:<br>Inverter error                                   | Indicate or<br>Error code :   |  |  |  |
|---|---|--|--|--|
| Detective Actuators:<br>Outdoor unit Main PCB   | Detective details:     Error information received from Outdoor unit Main PCB    |  |  |  |
| Forecast of Cause :       1. External cause.       2         3. Outdoor unit Main PCB failure       2 | 1. External cause.       2. Power supply to Main PCB wiring disconnection, open |  |  |  |
| Check Point 1-1 : Turn the power on aga<br>• Error displayed again?<br>YES                            | in?   | NO   |  |  |
| Check Point 2 : Check the wiring  |   | Check Point 1-2: External cause  |  |  |
| <ul> <li>Connector and wiring connection state che</li> <li>Cable open check</li> </ul>               | eck   | <ul> <li>Check if temporary voltage drop was not generated.</li> <li>Check if temporary open was not generated.</li> <li>Check if ground is connected correctly or<br/>there are no related cables near the power line.</li> </ul> |  |  |
| ок  |   |  |  |  |
| Check Point 3 : Replace Main PCB  |   |  |  |  |
| • Replace Outdoor unit Main PCB.  |   |  |  |  |

| Trouble shooting 20   | Indicate or Display  | <u></u>                |                    |  |  |
|---|--|------------------------|--------------------|--|--|
| OUTDOOR UNIT Error Method:<br>PFC circuit error   | Error code : 64  | Outdoor un             | it : No indication |  |  |
| Detective Actuators:  | Detective details:   |                        |                    |  |  |
| Outdoor unit Main PCB   | When inverter output DC voltage is higher than 415V(14 type) or<br>420V(18 type) for over 3 seconds, the compressor stops.<br>If the same operation is repeated 5 times, the compressor stops permanently. |                        |                    |  |  |
| Forecast of Cause :   |  |                        |                    |  |  |
| 1. External cause 2. Connecto   | r connection failure   | 3. Main PCB failure    |                    |  |  |
|   |  |                        |                    |  |  |
| Check Point 1 : Check external cause at   | Indoor and Outdoor (   | Voltage drop or Noise) |                    |  |  |
| <ul> <li>Instant drop : Check if there is a large load electric apparatus in the same circuit.</li> <li>Momentary power failure : Check if there is a defective contact or leak current<br/>in the power supply circuit.</li> </ul> |  |                        |                    |  |  |
| <ul> <li>Noise : Check if there is any equipment causing harmonic wave near electric line.<br/>(Neon bulb or electric equipment that may cause harmonic wave)<br/>Check the complete insulation of grounding.</li> </ul>            |  |                        |                    |  |  |
| ОК  |  |                        |                    |  |  |
| Check Point 2 : Check connection of Co  | Check Point 2 : Check connection of Connector  |                        |                    |  |  |
| <ul> <li>Check if connector is removed.</li> <li>Check erroneous connection.</li> <li>Check if cable is open.</li> <li>&gt;&gt;Upon correcting the removed connector or mis-wiring, reset the power.</li> </ul>                     |  |                        |                    |  |  |
| ок  |  |                        |                    |  |  |
| Check Point 3 : Replace Main PCB  |  |                        |                    |  |  |
| ▶ If Check Point 1, 2 do not improve the symptom, change Main PCB.  |  |                        |                    |  |  |
|   |  |                        |                    |  |  |

| Trouble shooting 21                                 | Indicate or Display:                      |  |
|---|---|--|
| OUTDOOR UNIT Error Method:<br>Trip terminal L error | Error code : 65                           | Outdoor unit : No indication               |
| Detective Actuators:                                | Detective details:                        |  |
| Outdoor unit Main PCB                               | When the signal from while the compressor | FO terminal of IPM is "L"(=0V)<br>r stops. |

#### Forecast of Cause:


1. Outdoor unit Main PCB failure

Check Point 1 : Replace Main PCB

Replace Outdoor unit Main PCB.


| Trouble shooting 22<br><u>OUTDOOR UNIT Error Method:</u><br>Discharge Thermistor Error | Indicate or Display:<br>Error code : 71         | Outdoor unit : No indication      |
|--|---|-----------------------------------|
| Detective Actuators:<br>Discharge temperature thermistor                               | Detective details:<br>• Discharge temperature t | thermistor short or open detected |
| Forecast of Cause : 1. Connector of  | -   |                                   |



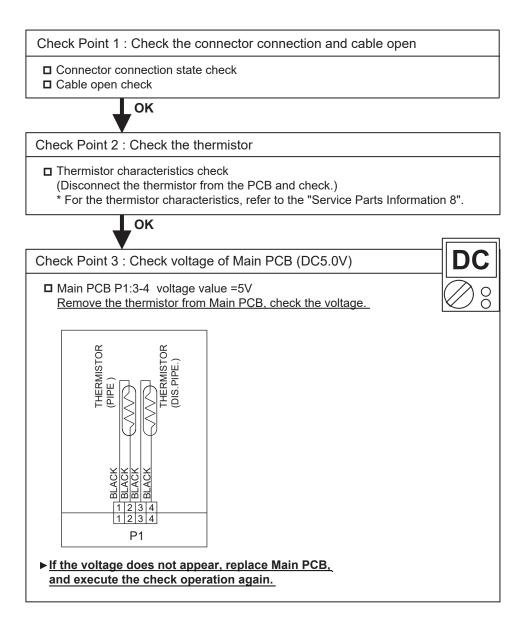


| Trouble shooting 23<br><u>OUTDOOR UNIT Error Method:</u><br>Compressor Temp. Thermistor Error | Indicate or Display:<br>Error code : 72                   | Outdoor unit : No indication |
|---|---|------------------------------|
| Detective Actuators:<br>Compressor temperature thermistor                                     | Detective details:<br>• Compressor temperature thermistor | short or open detected       |
| Forecast of Cause : 1. Connector con  | nection failure, open                                     |                              |



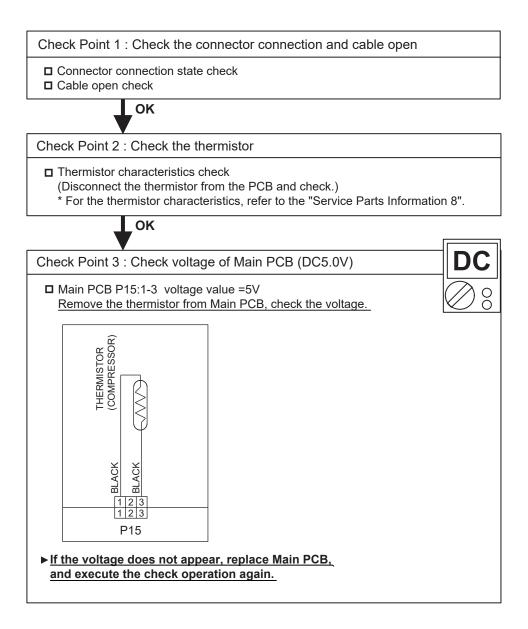


| Trouble shooting 24<br><u>OUTDOOR UNIT Error Method:</u><br>Heat Ex. Outlet / Middle Temp.<br>Thermistor Error | Indicate or Display:<br>Error code : 73 | Outdoor unit : No indication   |
|--|---|--|
| Detective Actuators:<br>Heat exchanger Outlet / Middle temperature<br>thermistor                               |   | emperature thermistor short or open detected temperature thermistor short or open detected |

| Forecast of Cause : | 1. Connector connection failure, open |
|---------------------|---------------------------------------|
|                     | 2. Thermistor failure                 |
|                     | 3. Main PCB failure                   |

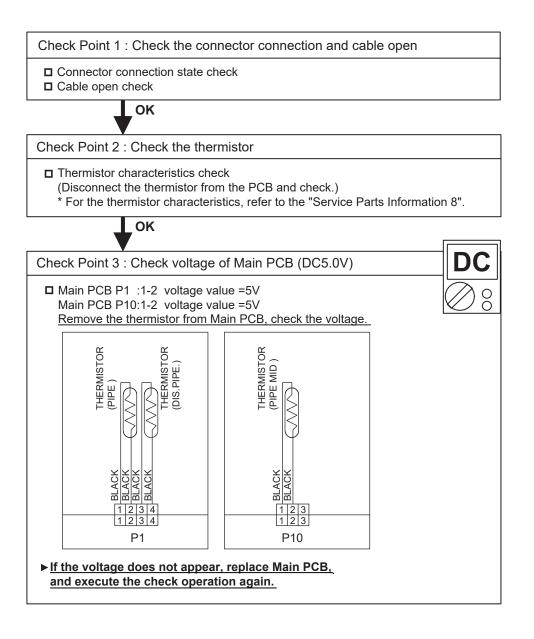


| Trouble shooting 25<br>OUTDOOR UNIT Error Method:<br>Outdoor Thermistor Error | Indicate or Display:<br>Error code : 74          | Outdoor unit : No indication  |
|---|--|-------------------------------|
| Detective Actuators:<br>Outdoor temperature thermistor                        | Detective details:<br>• Outdoor temperature them | mistor short or open detected |
| Forecast of Cause : 1. Connector connection failure, open                     |  |                               |



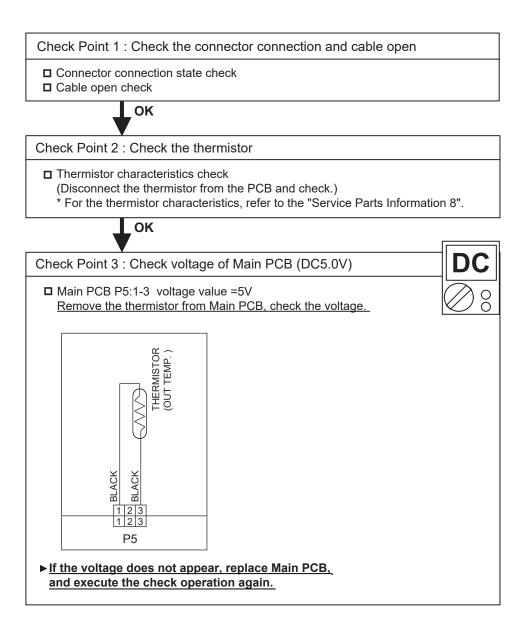


| Trouble shooting 26-1<br><u>OUTDOOR UNIT Error Method:</u><br>2-way Valve Thermistor Error | Indicate or Display:<br>Error code : 76            | Outdoor unit : No indication |
|--|--|------------------------------|
| Detective Actuators:<br>Outdoor temperature thermistor                                     | Detective details:<br>• Outdoor temperature thermi | istor short or open detected |
| Forecast of Cause : 1. Connector connection failure, open                                  |  |                              |




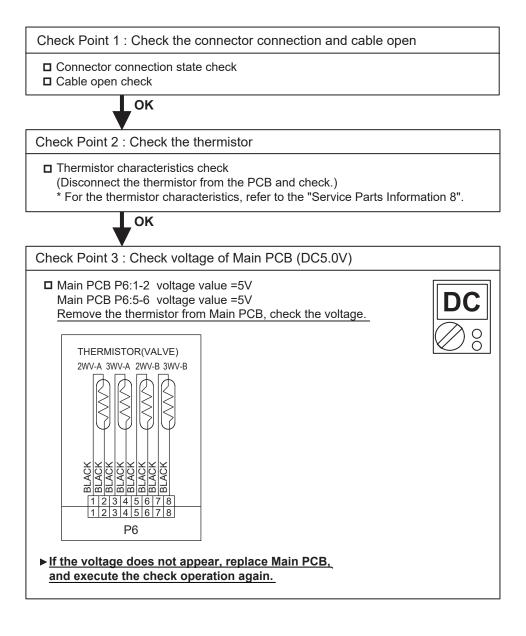


| Trouble shooting 26-2<br>OUTDOOR UNIT Error Method:<br>3-way Valve Thermistor Error | Indicate or Display:<br>Error code : 76         | Outdoor unit : No indication   |
|---|---|--------------------------------|
| Detective Actuators:<br>Outdoor temperature thermistor                              | Detective details:<br>• Outdoor temperature the | rmistor short or open detected |
| Forecast of Cause : 1. Connector connection failure, open                           |   |                                |



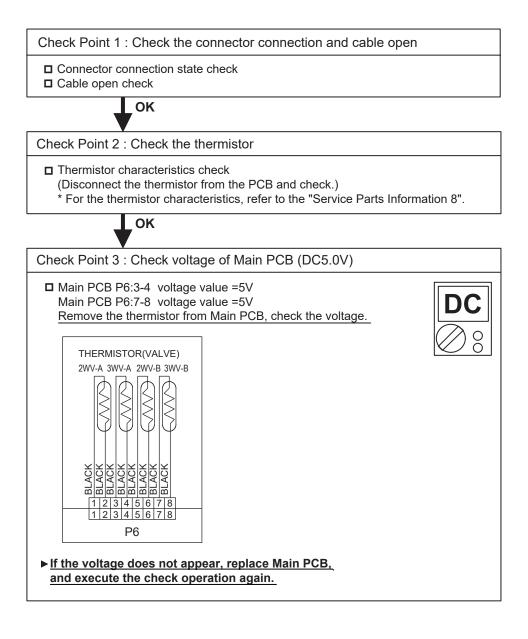


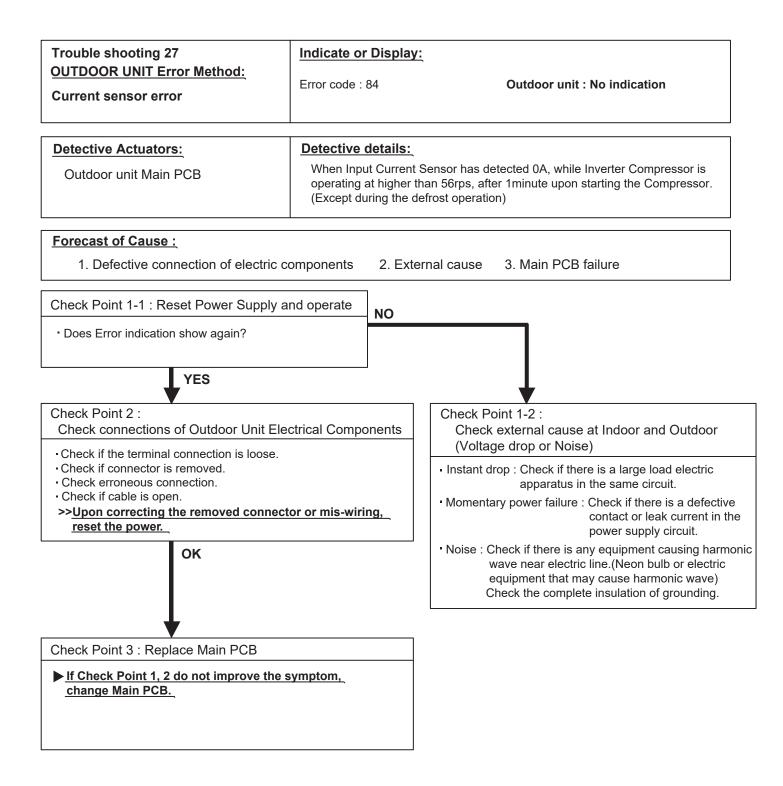

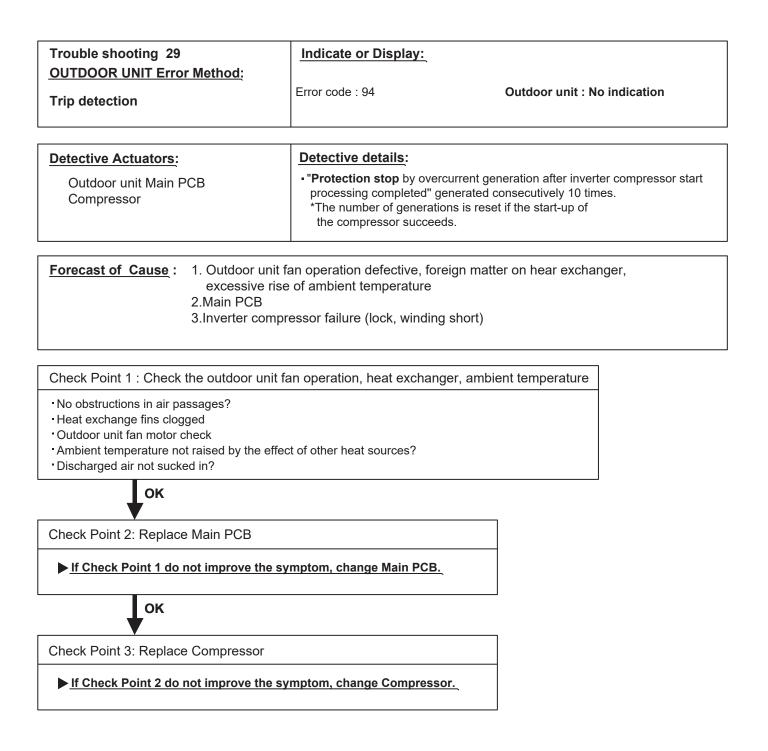

| Trouble shooting 30<br>OUTDOOR UNIT Error Method: | Indicate or Display: |   |
|---|----------------------|---|
| Compressor rotor position detection error         | Error code : 95      | Outdoor unit : No indication  |
| Detective Actuators:                              | Detective details:   |   |
| Outdoor unit Main PCB<br>Compressor               |                      | ercurrent generation at inverter compressor starting"<br>secutively 50 times x 3 sets (total 150 times) |
| Forecast of Cause :                               |                      |   |


1. Defective connection of electric components 2. Main PCB failure 3. Compressor failure

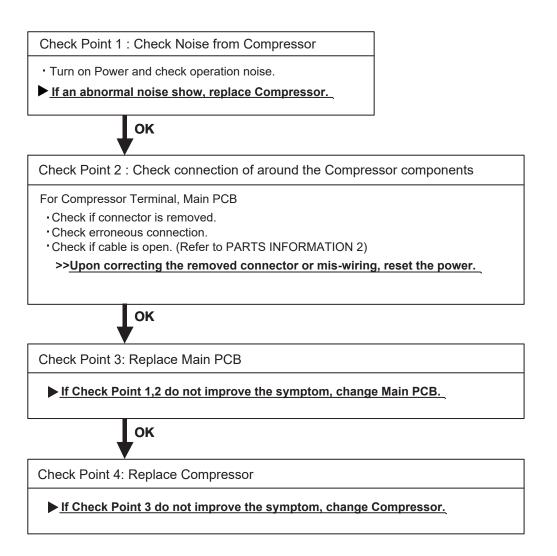

| Trouble shooting 31<br>OUTDOOR UNIT Error Method:<br>Outdoor Unit Fan Motor Error | Indicate or Display:<br>Error code : 97  | Outdoor unit : No indication |
|---|--|------------------------------|
| Detective Actuators:  | Detective details:   |                              |
| Outdoor unit Main PCB<br>Outdoor unit fan motor                                   | <ol> <li>When outdoor fan rotation speed is less than 100rpm in 20 seconds<br/>after fan motor starts, fan motor stops.</li> <li>After fan motor restarts, if the same operation within 60sec is repeated<br/>3 times in a row, compressor and fan motor stops.</li> <li>If ① and ② repeats 5 times in a row, compressor and fan motor stops<br/>permanently.</li> </ol> |                              |

#### Forecast of Cause:


- 1. Fan rotation failure 2. Motor protection by surrounding temperature rise 3. Main PCB failure
- 4. Outdoor unit fan motor failure

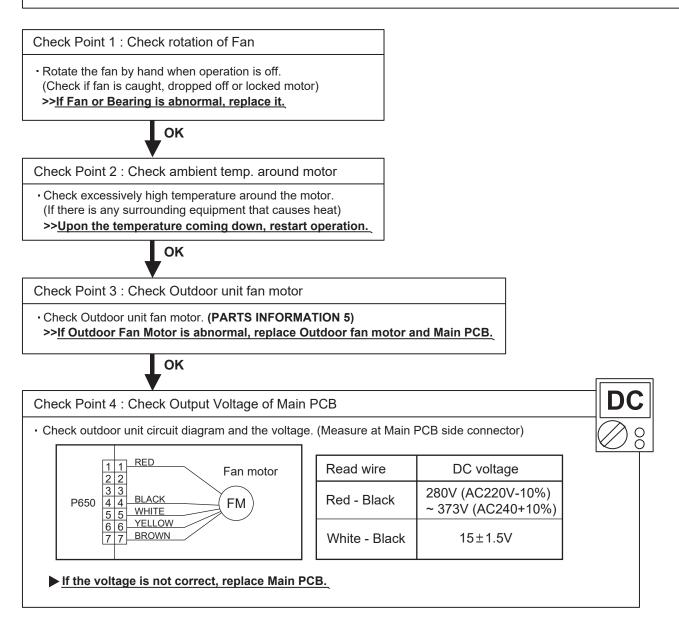

| Trouble shooting 32<br>OUTDOOR UNIT Error Method:   | Indicate or Display:   |                              |
|---|--|------------------------------|
| 4-Way Valve Error   | Error code : 99  | Outdoor unit : No indication |
| Detective Actuators:  | Detective details:   |                              |
| Indoor Unit Controller PCB Circuit<br>Heat Exchanger Temperature Thermistor<br>Room Temperature Thermistor<br>4-way valve | Detective details:         When the indoor heat exchanger temperature is compared with the room temperature, and either following condition is detected continuously two times, the compressor stops.         • Cooling or Dry operation         [Indoor heat exchanger temp.] - [Room temp.] > 10°C         • Heating operation             [indoor heat exchanger temp.] - [Room temp.] < -10°C         If the same operation is repeated 5 times, the compressor stops permanently. |                              |

#### Forecast of Cause :

1. Connector connection failure 2. Thermistor failure 3. Coil failure 4. 4-way valve failure 5. Main PCB failure

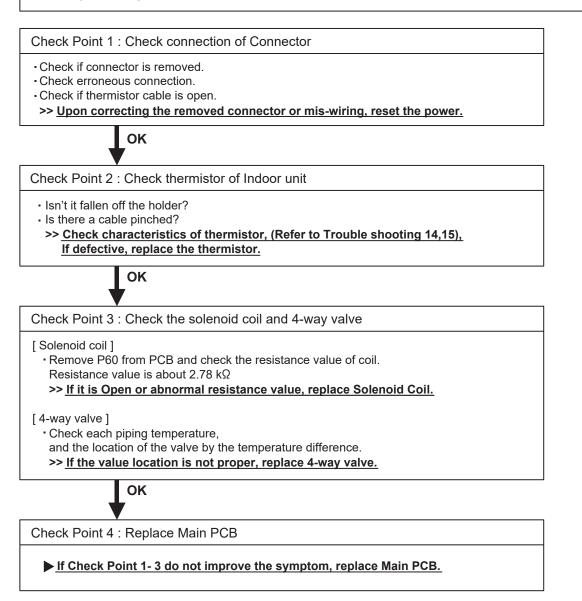

| Trouble shooting 33<br>OUTDOOR UNIT Error Method:<br>Discharge Temp. Error                     | Indicate or Dis   | splay:<br>Outdoor unit : No indication   |
|--|---|--|
| Detective Actuators:<br>Discharge temperature thermistor                                       |   | ails:<br>top by "discharge temperature ≧ 110°C during compressor<br>generated 2 times within 24 hours. |
|  | strainer clogged<br>eration failure, fore<br>erature thermistor | ign matter on heat exchanger<br>failure  |
| <cooling operation=""></cooling>   |   | <heating operation=""></heating>   |
| Check Point 1 : Check if 3-way valve(gas side  | e) is open.   | Check Point 1 : Check if 3-way valve(liquid side) is open.   |
| If the 3-way valve(gas side) was closed, open to<br>3-way valve(gas side) and check operation. | he  | If the 3-way valve(liquid side) was closed,<br>open the 3-way valve(liquid side) and check operation.  |
| ок   |   | ок   |
| Check Point 2 : Check the EEV, strainer  |   | Check Point 2 : Check the EEV, strainer  |
| EEV open?  |   | EEV open?  |

□ Strainer clogging check (before and after EEV, ACM, oil return) Refer to "Service Parts Information 3"

οκ

Check if fan can be rotated by hand. Motor check(PARTS INFORMATION 5) ΟΚ Check Point 4 : Check the discharge temp. thermistor  $\hfill\square$  Discharger temp. thermistor characteristics check (Check by disconnecting thermistor from PCB. Refer to the Troubleshooting 22) ΟΚ

Check Point 3 : Check the outdoor unit fan,heat exchanger

Check Point 5 : Check the refrigerant amount

Leak check

□ Strainer clogging check

(before and after EEV, ACM, oil return)

OK

 $\ensuremath{\square}$  Check for foreign object at heat exchanger

Refer to "Service Parts Information 3"


#### 2-3 TROUBLESHOOTING WITH NO ERROR CODE

#### **Trouble shooting 34**

Indoor Unit - No Power

#### Forecast of Cause:

- 1. Power Supply failure 2. External cause
- 3. Electrical Components defective

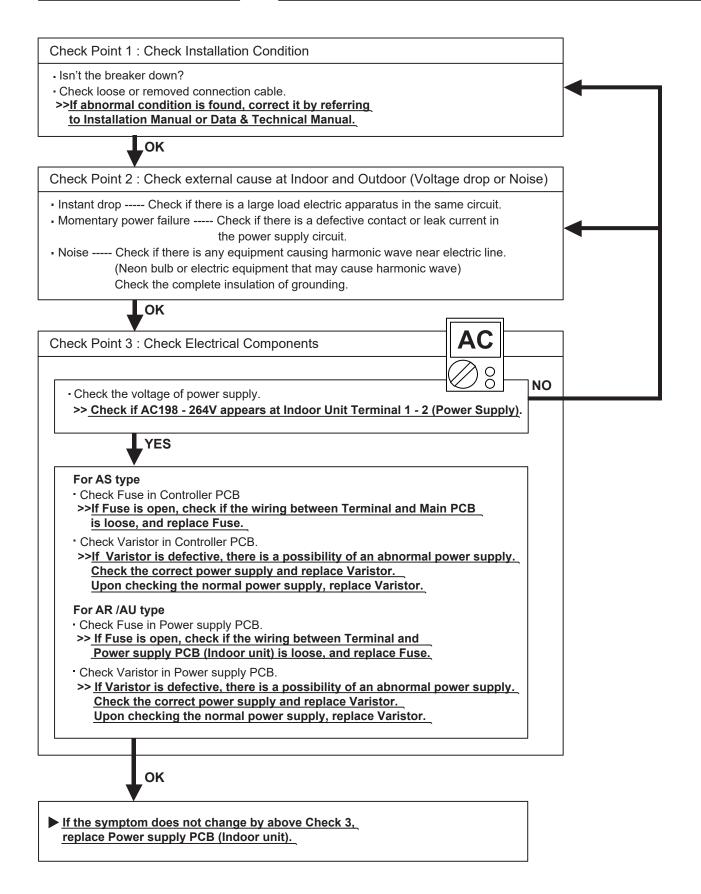


#### Trouble shooting 35

Outdoor unit - No Power

#### Forecast of Cause:

1.Power Supply failure 2. External cause 3.Electrical Components defective

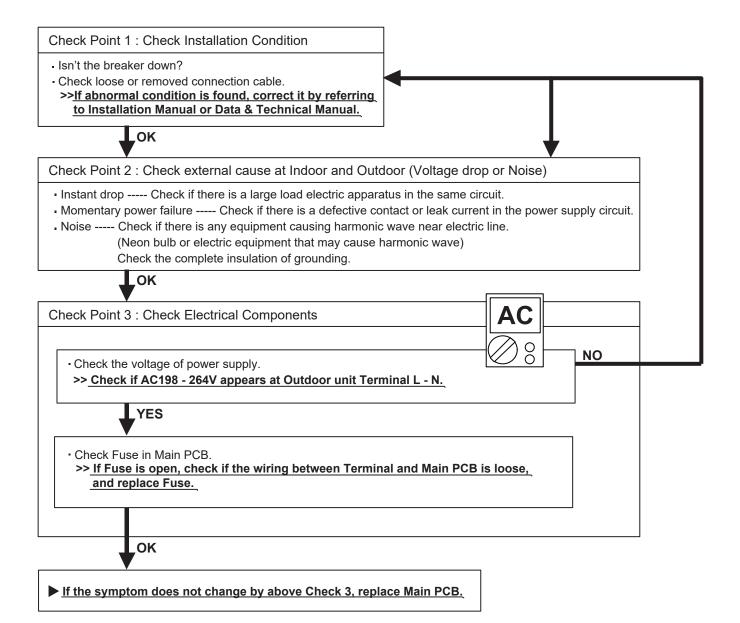



#### Trouble shooting 36


No Operation (Power is ON)

#### Forecast of Cause:

- 1. Setting/ Connection failure 2. External cause
- 3. Electrical Component defective

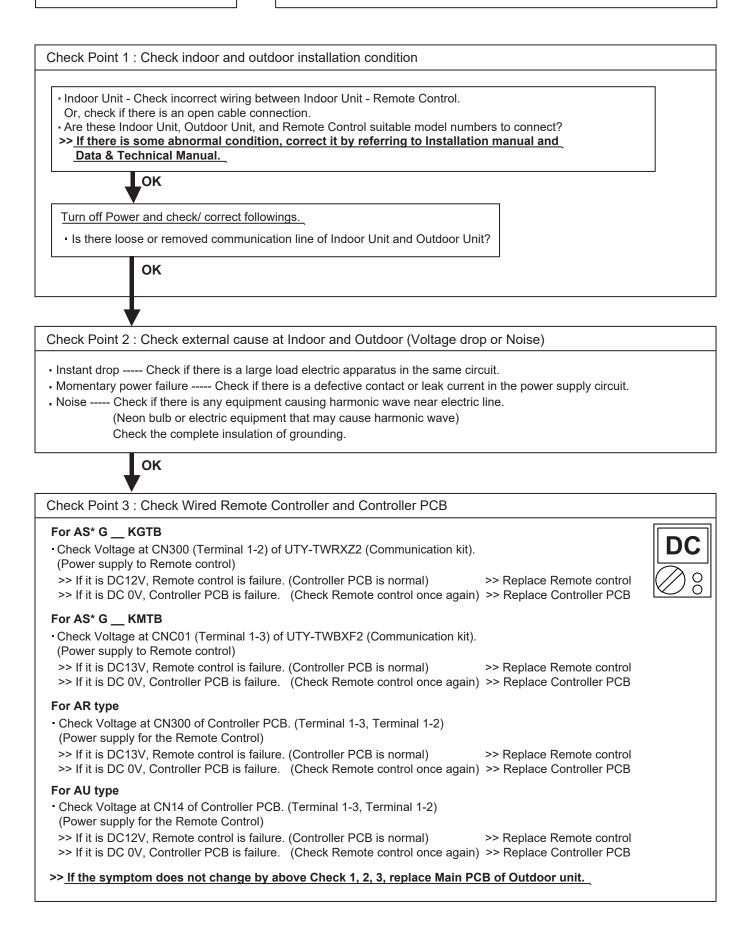

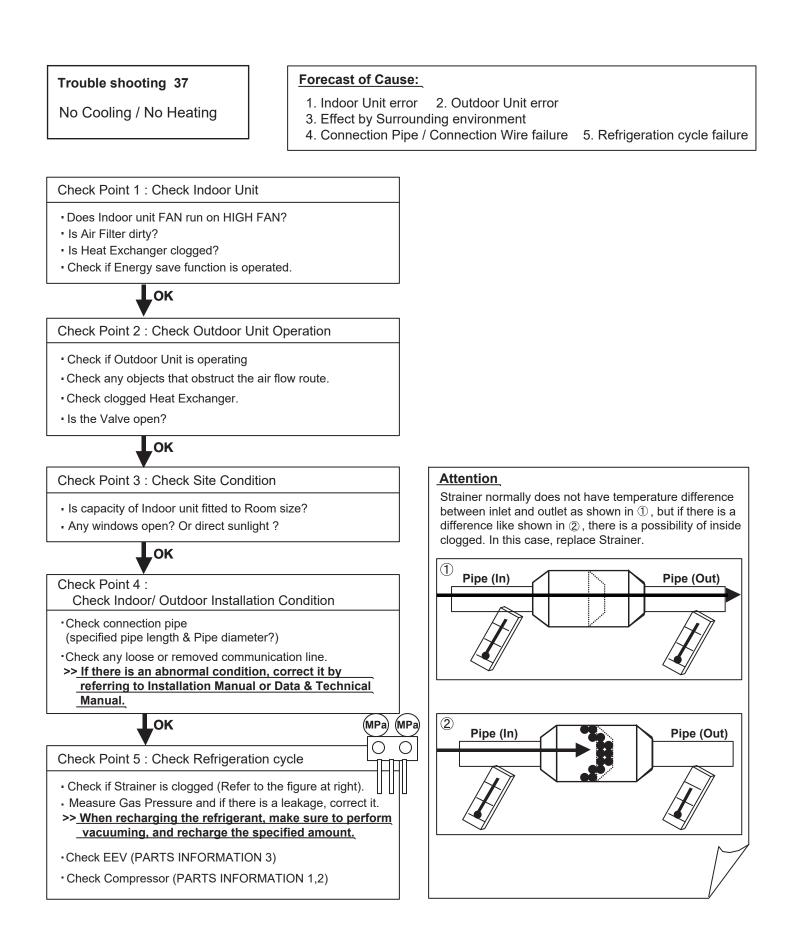

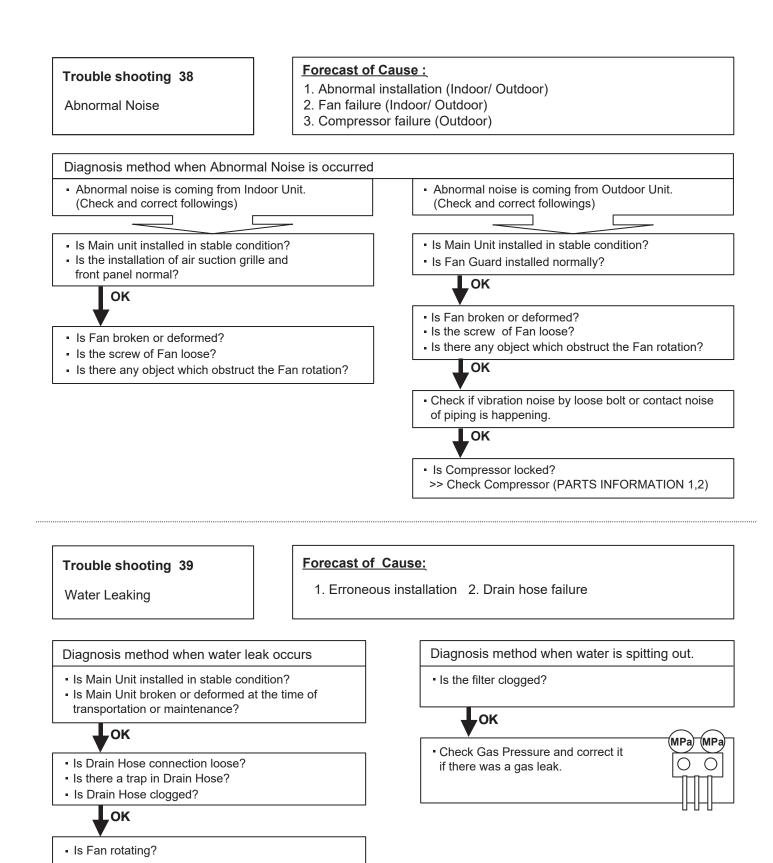


02-39

### 2-4 SERVICE PARTS INFORMATION


#### SERVICE PARTS INFORMATION 1


Compressor

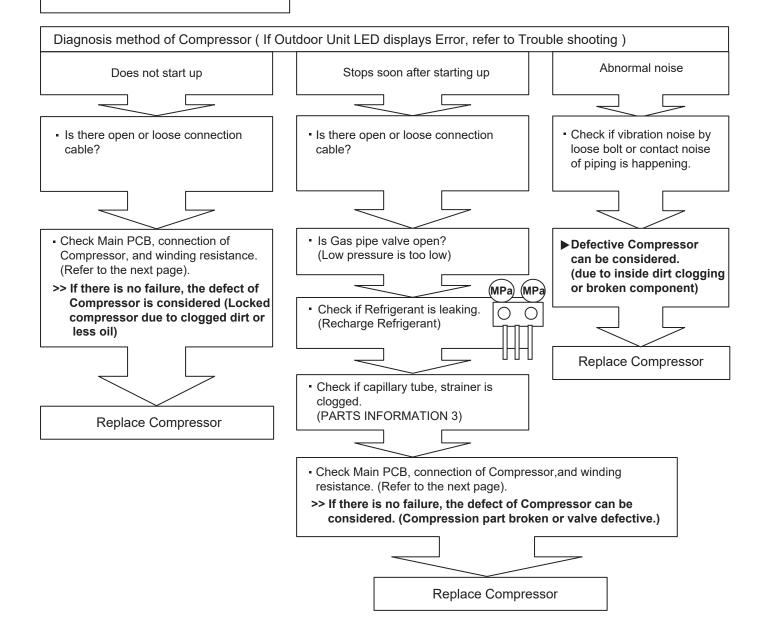

#### **SERVICE PARTS INFORMATION 2**


Inverter Compressor

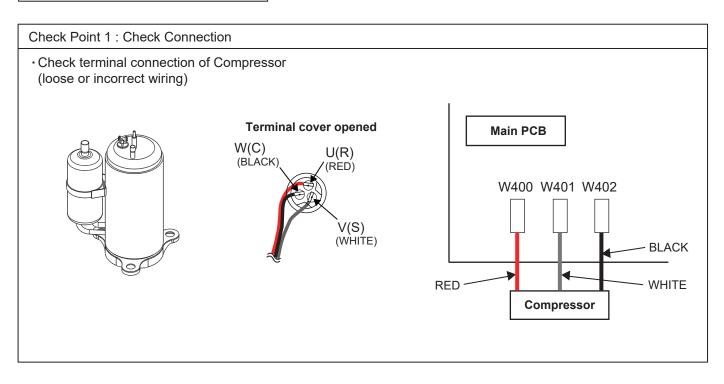


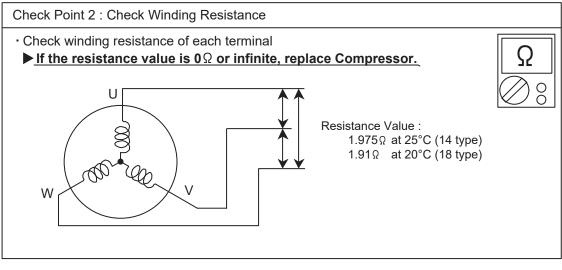

Check Point 3 : Replace Main PCB


▶ If the symptom does not change with above Check 1, 2, replace Main PCB.

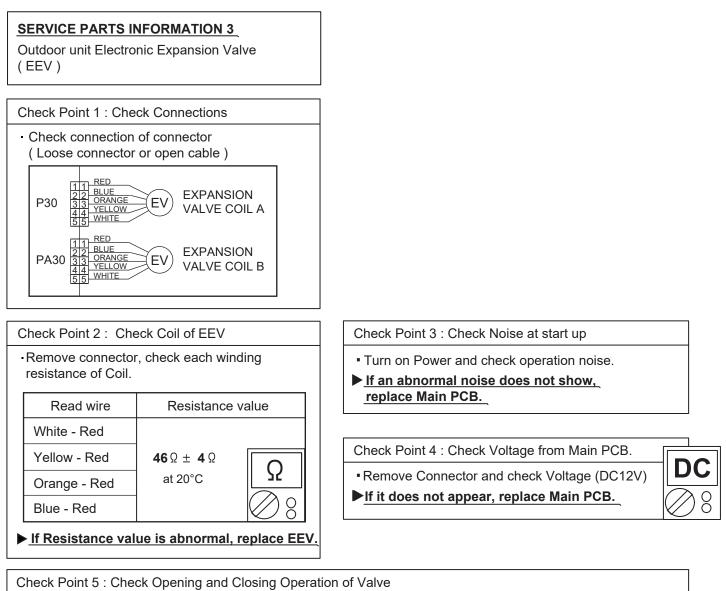

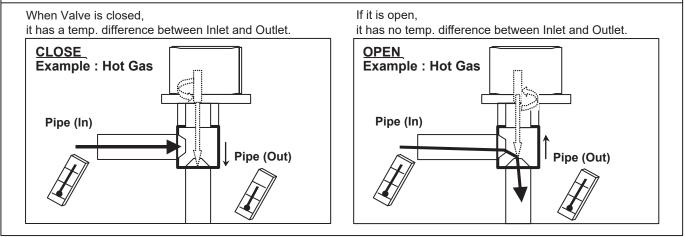

#### Check Point 6 : Check Strainer

Strainer normally does not have temperature difference between inlet and outlet as shown in (1), but if there is a difference as shown in (2), there is a possibility of inside clogged. In this case, replace Strainer.

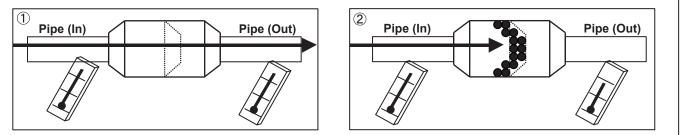

#### SERVICE PARTS INFORMATION 4

Indoor unit fan motor

Check Point 1 : Check rotation of Fan

 Rotate the fan by hand when operation is off. (Check if fan is caught, dropped off or locked motor)
 ><u>If Fan or Bearing is abnormal, replace it.</u>

Check Point 2 : Check resistance of Indoor unit Fan Motor

 Refer to below. Circuit-test "Vm" and "GND" terminal. (Vm: DC voltage, GND: Earth terminal)
 >If they are short-circuited (below 300 kΩ), replace Indoor unit fan motor and Controller PCB.

| Pin number<br>(wire color) | Terminal function<br>(symbol) |
|----------------------------|-------------------------------|
| 1 (Red)                    | DC voltage(Vm)                |
| 2                          | No function                   |
| 3                          | No function                   |
| 4 (Black)                  | (GND)                         |
| 5 (White)                  | Control voltage (Vcc)         |
| 6 (Yellow)                 | Speed command (Vsp)           |
| 7 (Brown)                  | Feed back (FG)                |



#### SERVICE PARTS INFORMATION 5

Outdoor unit fan motor

Check Point 1 : Check rotation of Fan

Rotate the fan by hand when operation is off.
 (Check if fan is caught, dropped off or locked motor)

>>If Fan or Bearing is abnormal, replace it.

Check Point 2 : Check resistance of Outdoor Fan Motor

Refer to below. Circuit-test "Vm" and "GND" terminal.
 (Vm: DC voltage, GND: Earth terminal)
 ><u>If they are short-circuited (below 300 kΩ), replace Outdoor fan motor and Main PCB.</u>

| Pin number<br>(wire color) | Terminal function<br>(symbol) |
|----------------------------|-------------------------------|
| 1 (Red)                    | DC voltage (Vm)               |
| 2                          | No function                   |
| 3                          | No function                   |
| 4 (Black)                  | Earth terminal (GND)          |
| 5 (White)                  | Control voltage (Vcc)         |
| 6 (Yellow)                 | Speed command (Vsp)           |
| 7 (Brown)                  | Feed back (FG)                |



#### SERVICE PARTS INFORMATION 8

#### Thermistor

| Temperature<br>[°C]       | Resistance Value [ kΩ ]              |                    |                  |                                  |     |
|---------------------------|--------------------------------------|--------------------|------------------|----------------------------------|-----|
|                           | Thermistor A                         | Thermistor B       | Thermistor C     | Thermistor D                     |     |
| -30                       | 1013.1                               | 95.6               | 224.3            | 1013.1                           |     |
| -20                       | 531.6                                | 50.3               | 115.2            | 531.6                            |     |
| -10                       | 292.9                                | 27.8               | 62.3             | 292.9                            |     |
| 0                         | 168.6                                | 16.1               | 35.2             | 168.6                            |     |
| 10                        | 100.9                                | 9.6                | 20.7             | 100.9                            |     |
| 20                        | 62.5                                 | 6.0                | 12.6             | 62.5                             |     |
| 30                        | 40.0                                 | 3.8                | 8.0              | 40.0                             | Ω   |
| 40                        | 26.3                                 | 2.5                | 5.2              | 26.3                             |     |
| 50                        | 17.8                                 | 1.7                | 3.5              | 17.8                             | 108 |
| 60                        | 12.3                                 | 1.2                | 2.4              | 12.3                             |     |
| 70                        | 8.7                                  | 0.8                | 1.6              | 8.7                              |     |
| 80                        | 6.3                                  | 0.6                | 1.2              | 6.3                              | 1   |
| 90                        | 4.6                                  |                    |                  |                                  |     |
| 100                       | 3.4                                  |                    |                  |                                  |     |
| 110                       | 2.6                                  |                    |                  |                                  |     |
| 120                       | 2.0                                  |                    |                  |                                  |     |
| Applicable<br>Thermistors | Discharge temp. TH<br>Comp. temp. TH | Heat exchanger. TH | Outdoor temp. TH | 2-way valve TH<br>3-way valve TH |     |
|                           |                                      |                    |                  |                                  |     |



# FUJITSU GENERAL LIMITED

3-3-17, Suenaga, Takatsu-ku, Kawasaki 213-8502, Japan